


**KANKAKEE VALLEY R.E.M.C. 100 AMP SERVICE RISER  
RECOMMENDATIONS**

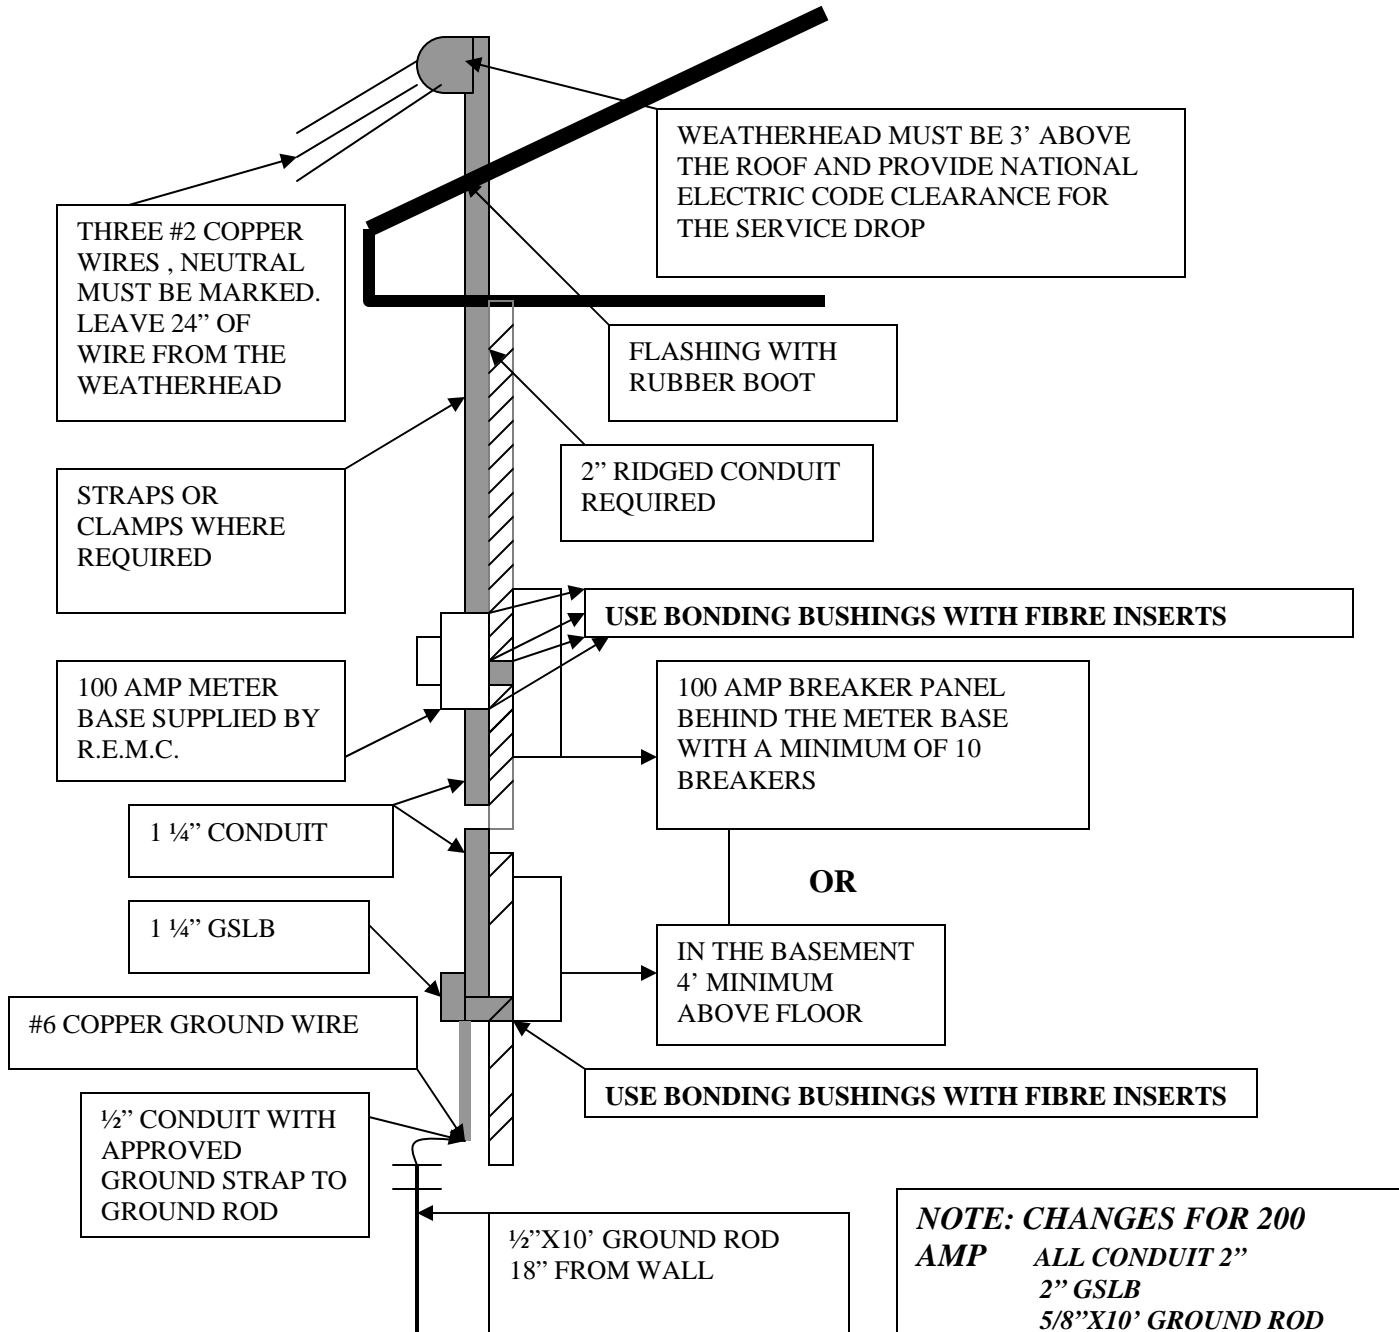

**NOTE: CHANGES FOR 200 AMP**

**ALL CONDUIT 2"**

**2" GSLB**

**5/8"X10' GROUND ROD**

**200 AMP BREAKER PANEL**

**2/0 COPPER OR 4/0 ALUMINUM INSTEAD OF #2**

**200 AMP METER BASE SUPPLIED BY R.E.M.C.**

**ALL OTHER RECOMMENDATIONS THE SAME**

**# 4 COPPER FOR GROUND**